





Connection with isolator switch

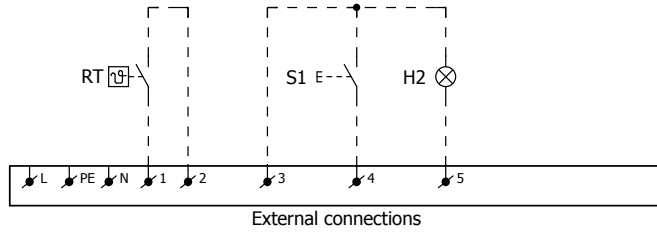

Power supply  
1~ 230V + N + PE / 50Hz  
I=3A (Istart=12,5A)



- | BM - Burner fan
- | F1,F2 - Fuse
- | H1,H2 - Alarm light
- | H3 - On
- | IS - Ionization bar
- | K1,K2 - Auxiliary relay
- | LD2 - Pressure switch
- | OT - Ignition transformer
- | Q1 - Motor relay
- | RT - Room thermostat
- | S1 - Reset button
- | TR - Transformer
- | TR1 - Time relay
- | VA1/VA2 - Gasvalve
- | WS - Isolator switch
- | Z1 - Netfilter

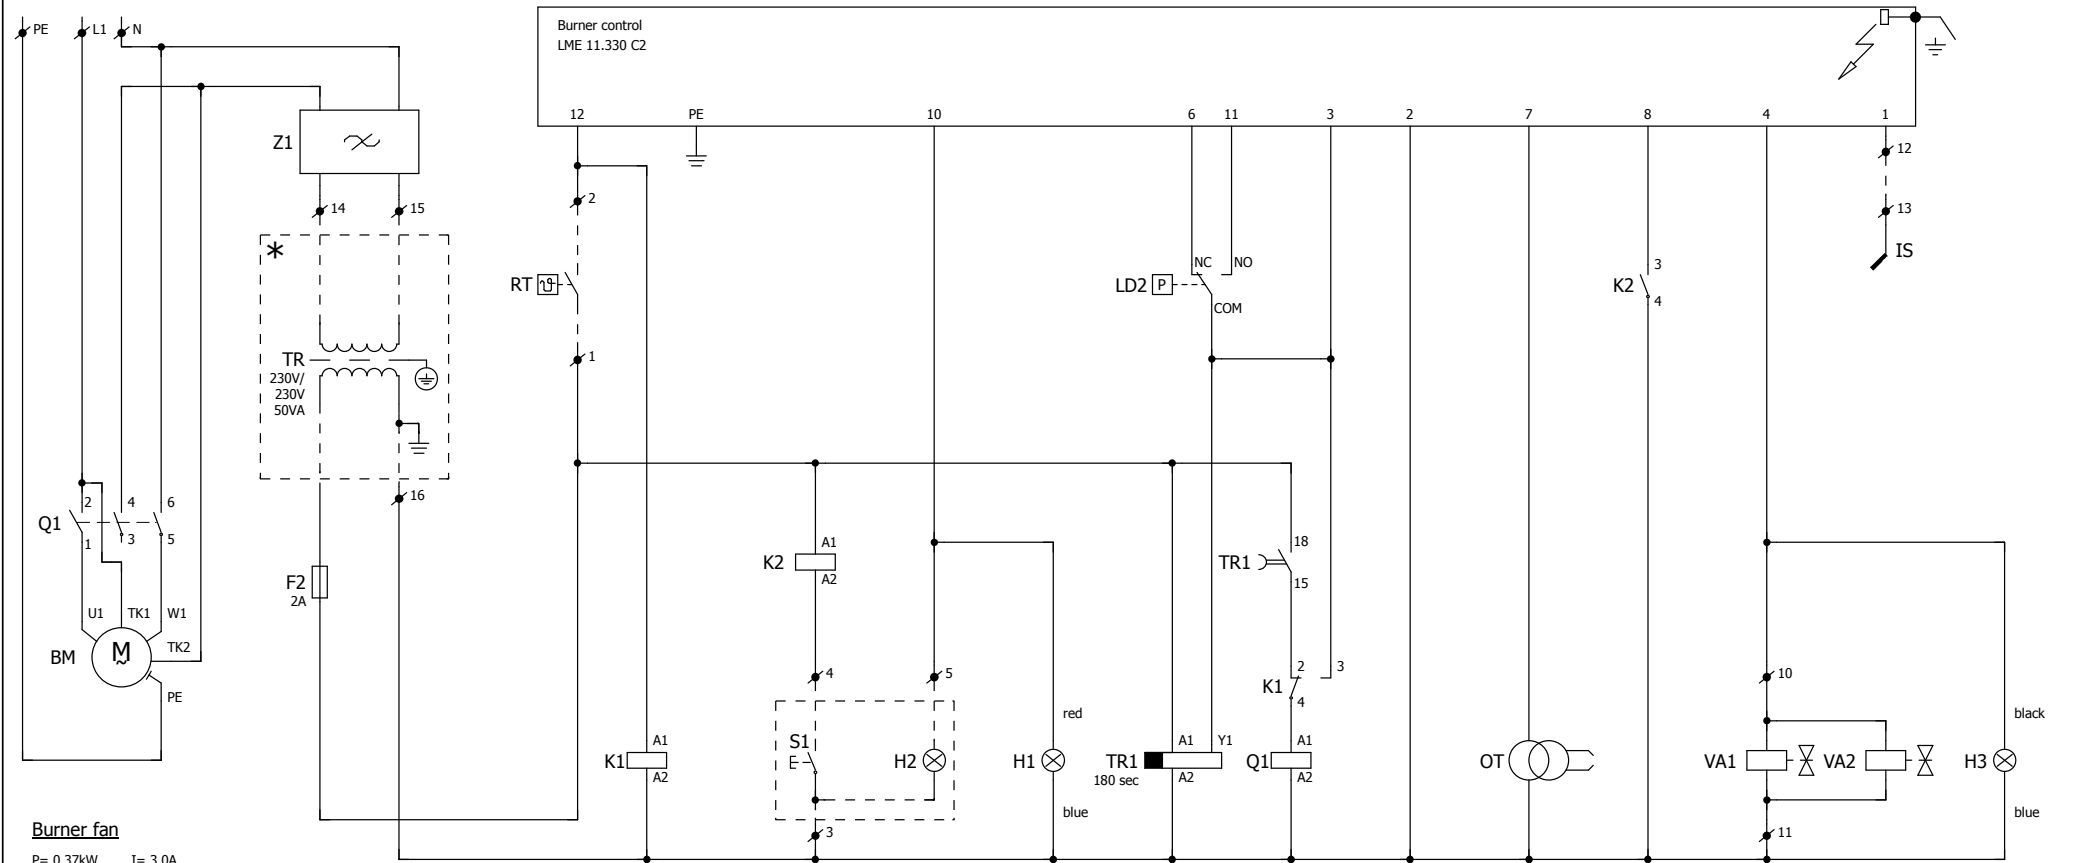

**Burner fan**  
P= 0.37kW I= 3.0A

\* For heaters with transformer

Infra-Line  
on/off

Electrical drawing

Drawing number

IL-001000-EN

Get.	TvD	Date	21-2-2020
Gec.		Norm	

Group	IL	Type	Infra-Line
Art.nr	30.03.192	Version	1.4